

RAW INFLUENT STRENGTH (Heart of the Valley Metropolitan Sewerage Facility)

September 2024

MONTH	FLOW		TSS			BOD			TOTAL PHOSPHORUS			AMMONIA			CHLORIDE		
	Million * Gallons	Avg MGD	Avg mg/L	Avg #/day	Total #/Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L	Avg #/day	Total # Month
Jan	195.7	6.3	200	10,529	322,474	239	12,606	384,941	4.62	243	7,271	35.0	1841	55,081	735	38,714	1,185,582
Feb	200.5	6.9	203	11,712	335,199	231	13,306	380,481	4.81	277	7,753	31.5	1815	51,806	671	38,668	1,110,798
Mar	201.0	6.5	202	10,905	331,561	230	12,440	375,775	4.69	253	7,706	33.5	1811	55,173	683	36,936	1,126,901
Apr	252.4	8.4	164	11,479	320,482	185	12,958	363,130	3.68	258	7,309	26.0	1827	51,734	612	42,964	1,235,989
May	233.9	7.5	175	11,028	333,803	200	12,578	380,309	3.95	249	7,343	27.1	1708	51,132	598	37,655	1,093,982
Jun	271.5	9.1	144	10,869	300,719	169	12,757	351,636	3.59	271	7,666	22.6	1704	47,274	515	38,842	1,123,849
Jul	290.9	9.4	145	11,388	329,615	161	12,588	353,460	3.33	260	7,124	21.0	1642	48,564	522	40,883	1,212,590
Aug	249.3	8.0	172	11,526	345,199	192	12,890	386,875	3.91	263	7,898	25.0	1677	51,636	572	38,381	1,174,503
Sep	161.6	5.4	229	10,296	307,005	260	11,668	347,786	5.32	239	7,050	36.2	1628	48,543	766	34,418	1,022,016
Oct																	
Nov																	
Dec																	
Average	228.5	7.5	182	11,081	325,117	207	12,644	369,377	4.21	257	7,458	28.7	1,739	51,216	631	38,607	1,142,912
Yearly Total	2,056.8				2,926,057			3,324,392			67,120			460,943			10,286,210
*Includes Hauled Waste [Plant Design Capacity] =		8.5		13,565			12,209			339			1,600				
(Hauled Waste Gallons)= 236,890 [Max Design Capacity] =		11.9		16,278			14,651			407			1,920				
September % of Capacity		45%		63%			80%			59%			85%				

September Max Daily Flow 6.82


EFFLUENT QUALITY

MONTH	FLOW		TSS			BOD			TOTAL PHOSPHORUS			AMMONIA			CHLORIDE
	Million Gallons	Avg MGD	Avg mg/L	Avg #/day	Total #/Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L	Avg #/day	Total # Month	Avg mg/L
Jan	109.3	3.5	11.8	346	10,416	10.3	304	9,284	0.40	11.9	357	0.38	11.3	329	755
Feb	115.5	4.0	6.8	225	6,461	6.1	203	5,842	0.26	8.5	236	0.19	6.3	158	672
Mar	111.9	3.6	7.2	217	6,567	5.9	177	5,383	0.28	8.5	255	0.24	7.2	189	700
Apr	189.5	6.3	6.9	365	11,440	5.4	285	8,512	0.25	13.1	384	0.20	10.5	294	583
May	131.7	4.2	9.0	319	10,633	7.6	268	8,763	0.46	16.2	487	0.41	14.4	486	586
Jun	177.3	5.9	6.7	330	9,565	5.6	278	8,088	0.21	10.5	307	0.27	13.4	309	498
Jul	189.4	6.1	5.0	257	7,682	5.2	266	8,278	0.16	8.2	249	0.21	10.9	380	522
Aug	146.6	4.7	6.3	249	7,560	4.2	166	4,991	0.16	6.3	198	0.17	6.8	204	557
Sep	67.9	2.3	11.3	214	6,260	6.7	127	3,714	0.22	4.1	120	0.47	8.8	380	775
Oct															
Nov															
Dec															
Average	137.7	4.5	7.9	280	8,510	6.3	230.4	6,984	0.27	9.7	288.0	0.28	10.0	303.3	628
Yearly Total	1,239.1				76,586			62,855			2,592			2,729.6	


Effluent Gallons to Fox Energy (September)	September	Avg #/s		6 mo. Avg #/s	8.89	May-Oct
	WEEK 1	224				
	WEEK 2	205				
	WEEK 3	138				
93.70	58%					

{PERMIT LIMITS (WDNR) →	Monthly (Avg)	801#	Monthly Avg	30 mg/L	Monthly Avg	31.5#	Jan- Marc	10 mg/L
	Weekly (Avg)	1345#	Weekly Avg	45 mg/L	6 mo Avg	10.5#	April-May	11 mg/L
	Daily Max (mg/L)	30	WLA May-Oct		Daily Max mg/L	1.0	June-Sept	4.4 mg/L
							Oct-Dec	18 mg/L


Influent TSS Total Pounds/Mo.

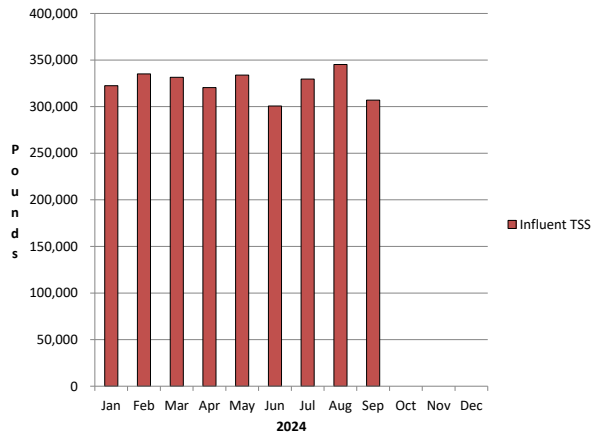


Influent BOD Total Pounds / Mo.

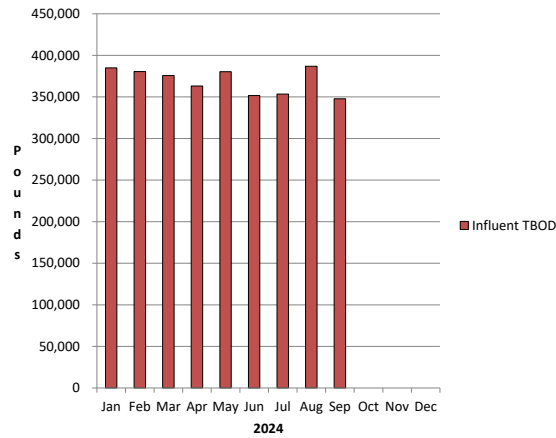


Influent Phosphorus Total Pounds/Mo.

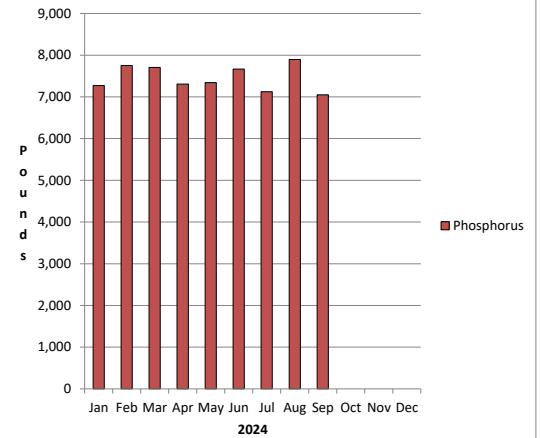


Influent Ammonia Total Pounds/Mo.

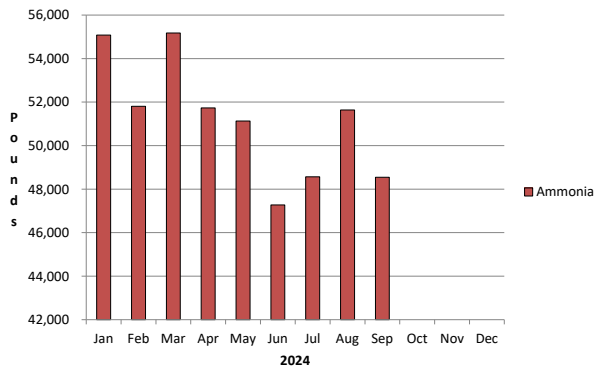

Avg Influent MGD/Mo.

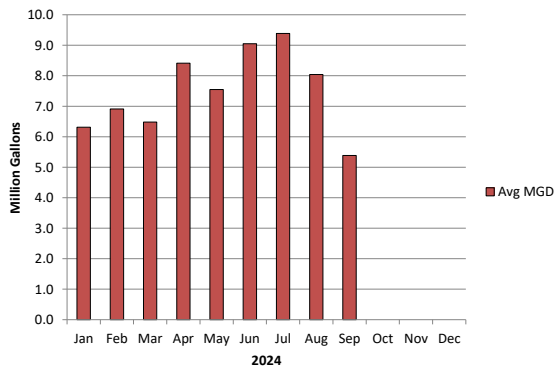

Influent Chloride Total Pounds/Mo.

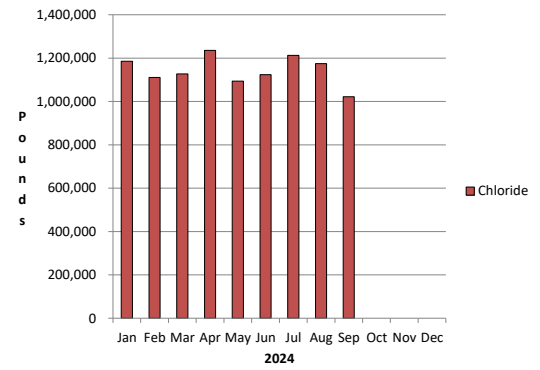

RAIN GAUGES

DAILY RAINFALL TOTALS

MONTH: SEPTEMBER

YEAR: 2023

<u>DATE</u>	<u>PLANT INCHES</u>	<u>KAUKAUNA INCHES</u>	<u>LITTLE CHUTE INCHES</u>	<u>KIMBERLY INCHES</u>	<u>DARBOY INCHES</u>
1	0.00	0.00	0.00	0.00	0.00
2	0.00	0.00	0.00	0.00	0.00
3	0.00	0.00	0.00	0.00	0.00
4	0.00	0.00	0.00	0.00	0.00
5	0.14	0.13	0.13	0.13	0.16
6	0.00	0.00	0.00	0.00	0.00
7	0.00	0.00	0.00	0.00	0.00
8	0.00	0.00	0.00	0.00	0.00
9	0.00	0.00	0.00	0.00	0.00
10	0.00	0.00	0.00	0.00	0.00
11	0.00	0.00	0.00	0.00	0.00
12	0.00	0.00	0.00	0.00	0.00
13	0.00	0.00	0.00	0.00	0.00
14	0.00	0.00	0.00	0.00	0.00
15	0.00	0.00	0.00	0.00	0.00
16	0.00	0.00	0.00	0.00	0.00
17	0.00	0.00	0.00	0.00	0.00
18	0.00	0.00	0.00	0.00	0.00
19	0.00	0.00	0.00	0.00	0.00
20	0.10	0.08	0.09	0.10	0.11
21	0.31	0.34	0.39	0.40	0.55
22	0.33	0.33	0.40	0.43	0.62
23	0.00	0.00	0.00	0.00	0.01
24	0.00	0.00	0.00	0.00	0.00
25	0.00	0.00	0.00	0.00	0.00
26	0.00	0.00	0.00	0.00	0.00
27	0.00	0.00	0.00	0.00	0.00
28	0.00	0.00	0.00	0.00	0.00
29	0.00	0.00	0.00	0.00	0.00
30	0.00	0.00	0.00	0.00	0.00
TOTAL:	0.88	0.88	1.01	1.06	1.45